1512 S BATAVIA AVENUE

An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

GENEVA, IL 60134

630-232-0104

Test Report

Sound Absorption RALTM-A20-300

SPONSOR: FabriTRAK Systems Inc.

Mount Laurel, NJ

Page 1 of 8

ON: 1/2 in. Terra Core Poly High Density, Tackable, Hi Impact (100% Polyester Infill) (Type A

mounting)

TEST METHODOLOGY

CONDUCTED: 2020-07-14

Riverbank Acoustical LaboratoriesTM is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-17: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as 1/2 in. Terra Core Poly High Density, Tackable, Hi Impact (100% Polyester Infill) (Type A mounting). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Trade Name: Terra Core Poly High Density, Tackable, Hi Impact

Material: 100 % polyester infill Thickness: 12.7 mm (0.5 in.)

Manufacturer: FabriTRAK Systems Inc.

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Test Specimen

Material: Semirigid felt panels

Dimensions: 4 @ 1219.2 mm (48 in.) x 1219.2 mm (48 in.)

2 @ 304.8 mm (12 in.) x 1219.2 mm (48 in.)

Thickness: 13.67 mm (0.538 in.)

Overall Weight: 8.62 kg (19 lbs)

Density: 94.28 kg/m³ (5.89 lbs/ft³)



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RALTM-A20-300 Page 2 of 8

FabriTRAK Systems Inc. 2020-07-14

Overall Specimen Properties

Size: 2.74 m (108.0 in) wide by 2.44 m (96.0 in) long

Thickness: 0.01 m (0.538 in) Weight: 8.62 kg (19.0 lbs)

Mass per Unit Area: 1.29 kg/m² (0.26 lbs/ft²)

Calculation Area: 6.689 m² (72 ft²)

Test Environment


Room Volume: 291.98 m³

Temperature: $22.5 \,^{\circ}\text{C} \pm 0.1 \,^{\circ}\text{C}$ (Requirement: $\geq 10 \,^{\circ}\text{C}$ and $\leq 5 \,^{\circ}\text{C}$ change) Relative Humidity: $59.0 \% \pm 0.8 \%$ (Requirement: $\geq 40 \%$ and $\leq 5 \%$ change)

Barometric Pressure: 98.8 kPa (Requirement not defined)

MOUNTING METHOD

Type A Mounting: The test specimen was laid directly against the test surface. Perimeter edges were sealed with metal framing.



An MALION Technical Center

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RALTM-A20-300 Page 3 of 8

FabriTRAK Systems Inc. 2020-07-14

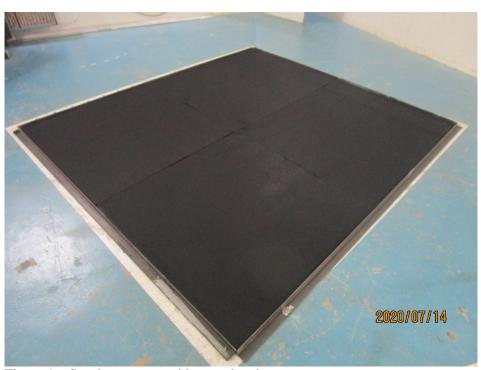


Figure 1 – Specimen mounted in test chamber



Figure 2 – Detail of specimen material



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

An MALION Technical Center

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RALTM-A20-300 Page 4 of 8


FabriTRAK Systems Inc. 2020-07-14

TEST RESULTS

Specimen total absorption and absorption coefficient are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages.

1/3 Octave Center			
Frequency	Total Absorption	Total Absorption	Absorption
(Hz)	(m^2)	(Sabins)	Coefficient
100	0.12	1.28	0.02
** 125	0.21	2.27	0.03
160	0.45	4.81	0.07
200	0.52	5.61	0.08
** 250	0.83	8.90	0.12
315	1.20	12.91	0.18
313	1.20	12.71	0.10
400	1.61	17.31	0.24
** 500	2.34	25.23	0.35
630	3.04	32.74	0.45
800	3.62	38.94	0.54
** 1000	4.08	43.88	0.61
1250	4.45	47.88	0.66
1230	4.43	47.00	0.00
1600	4.62	49.68	0.69
** 2000	4.83	51.97	0.72
2500	5.29	56.94	0.79
21.50	5.5 0	60.04	0.02
3150	5.58	60.04	0.83
** 4000	5.77	62.14	0.86
5000	6.17	66.45	0.92

SAA = 0.45NRC = 0.45



1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

RALTM**-A20-300** Page 5 of 8

FabriTRAK Systems Inc. 2020-07-14

TEST RESULTS (continued)

The sound absorption average (SAA) is defined in ASTM C423-17 Section 3.1.1 as the arithmetic average of the sound absorption coefficients of a material for the twelve one-third octave bands from 200 Hz through 2500 Hz, inclusive, rounded to the nearest integer multiple of 0.01.

The noise reduction coefficient (NRC) is defined from previous versions of ASTM C423 as the arithmetic average of the sound absorption coefficients at 250 Hz, 500 Hz, 1000 Hz, and 2000 Hz, rounded to the nearest integer multiple of 0.05.

Tested by // acc

Marc Sciaky

Senior Experimentalist

Report by_

Malcolm Kelly

Acoustical Test Engineer

Approved b

/ Eric P. Wolfram

Laboratory Manager

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

Test Report


RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

> RALTM-A20-300 Page 6 of 8

FabriTRAK Systems Inc. 2020-07-14

SOUND ABSORPTION REPORT

1/2 in. Terra Core Poly High Density, Tackable, Hi Impact (100% Polyester Infill) (Type A mounting)

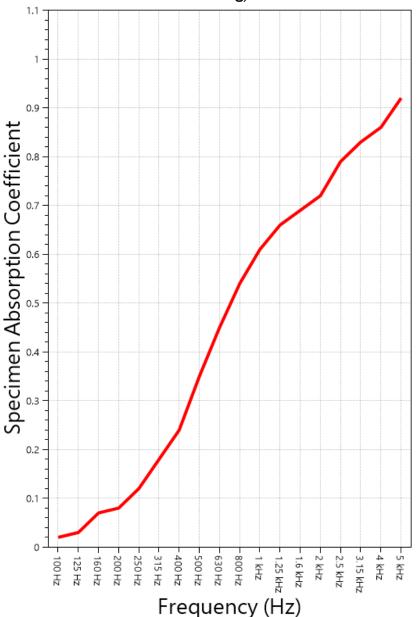

SAA = 0.45

NRC = 0.45



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT.

THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

An MALION Technical Center

Test Report

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

FabriTRAK Systems Inc. 2020-07-14

RALTM-A20-300 Page 7 of 8

APPENDIX A: Extended Frequency Range Data

1/3 Octave Rand

Specimen: 1/2 in. Terra Core Poly High Density, Tackable, Hi Impact (100% Polyester Infill) (Type A mounting) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-17, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band		
Center Frequency	Total Absorption	Absorption
(Hz)	(Sabins)	Coefficient
21.5	0.75	0.01
31.5	-0.75	-0.01
40	4.78	0.07
50	2.80	0.04
63	2.90	0.04
80	-9.66	-0.13
100	1.28	0.02
125	2.27	0.03
160	4.81	0.07
200	5.61	0.08
250	8.90	0.12
315	12.91	0.18
400	17.31	0.24
500	25.23	0.35
630	32.74	0.45
800	38.94	0.54
1000	43.88	0.61
1250	47.88	0.66
1600	49.68	0.69
2000	51.97	0.72
2500	56.94	0.79
3150	60.04	0.83
4000	62.14	0.86
5000	66.45	0.92
6300	71.83	1.00
8000	74.14	1.03
10000	77.19	1.07
12500	77.03	1.07



® RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE

SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

An MALION Technical Center

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

Test Report

RIVERBANK.ALIONSCIENCE.COM FOUNDED 1918 BY WALLACE CLEMENT SABINE

FabriTRAK Systems Inc. 2020-07-14

RALTM-A20-300 Page 8 of 8

APPENDIX B: Instruments of Traceability

Specimen: 1/2 in. Terra Core Poly High Density, Tackable, Hi Impact (100% Polyester Infill) (Type A mounting) (See Full Report)

		Serial	Date of	Calibration
<u>Description</u>	Model	Number	Certification	<u>Due</u>
System 1	Type 3160-A-042	3160- 106968	2020-06-26	2021-06-26
Bruel & Kjaer Mic And Preamp A	Type 4943-B-001	2311428	2019-09-27	2020-09-27
Bruel & Kjaer Pistonphone	Type 4228	2781248	2019-08-09	2020-08-09
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP- PRHTemp2000	P97844	2020-02-18	2021-02-18

APPENDIX C: Revisions to Original Test Report

Specimen: 1/2 in. Terra Core Poly High Density, Tackable, Hi Impact (100% Polyester Infill) (Type A mounting) (See Full Report)

<u>Date</u>	Revision	
2020-07-20	Original report issued	

END

