1512 S BATAVIA AVENUE GENEVA, IL 60134

630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Sound Absorption <u>RALTM-A20-301</u>

Page 1 of 8

CONDUCTED: 2020-07-14

ON: 1 in. Terra Core Poly Tackable Infill (100% Polyester Infill) (Type A mounting)

TEST METHODOLOGY

SPONSOR: FabriTRAK Systems Inc.

Mount Laurel, NJ

Riverbank Acoustical Laboratories[™] is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2017 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-17: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as 1 in. Terra Core Poly Tackable Infill (100% Polyester Infill) (Type A mounting). The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Trade Name:	Terra Core Poly Tackable Infill
Material:	100 % polyester infill
Thickness:	25.4 mm (1 in.)
Manufacturer:	FabriTRAK Systems Inc.

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full external visual inspection performed on the test specimen, Riverbank personnel verified the following information:

Material:	Semirigid felt panels
Dimensions:	4 @ 1219.2 mm (48 in.) x 1219.2 mm (48 in.)
	2 @ 304.8 mm (12 in.) x 1219.2 mm (48 in.)
Thickness:	25.25 mm (0.994 in.)
Overall Weight:	9.87 kg (21.75 lbs)
Density:	$58.42 \text{ kg/m}^3 (3.65 \text{ lbs/ft}^3)$



INVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

Test Report

WALLACE CLEMENT SABINE

FabriTRAK Systems Inc. 2020-07-14

RALTM-A20-301

Page 2 of 8

FOUNDED 1918 BY

Overall Specimen Properties

Size:	2.74 m (108.0 in) wide by 2.44 m (96.0 in) long
Thickness:	0.03 m (0.994 in)
Weight:	9.87 kg (21.75 lbs)
Mass per Unit Area:	1.47 kg/m ² (0.3 lbs/ft ²)
Calculation Area:	6.689 m ² (72 ft ²)

Test Environment

Room Volume:	291.98 m ³
Temperature:	22.6 °C \pm 0.0 °C (Requirement: \geq 10 °C and \leq 5 °C change)
Relative Humidity:	58.75 % \pm 0.3 % (Requirement: \geq 40 % and \leq 5 % change)
Barometric Pressure:	98.7 kPa (Requirement not defined)

MOUNTING METHOD

Type A Mounting: The test specimen was laid directly against the test surface. Perimeter edges were sealed with metal framing.



INVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

I 512 S BATAVIA AVENUE GENEVA, IL 60134

630-232-0104

An MALION Technical Center

Test Report

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY WALLACE CLEMENT SABINE

FabriTRAK Systems Inc. 2020-07-14

RALTM-A20-301 Page 3 of 8



Figure 1 – Specimen mounted in test chamber



Figure 2 – Detail of specimen material



(B) RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

RALTM-A20-301

Test Report

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Page 4 of 8

FabriTRAK Systems Inc. 2020-07-14

TEST RESULTS

Specimen total absorption and absorption coefficient are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages.

1/3 Octave Center			
Frequency	Total Absorption	Total Absorption	Absorption
(Hz)	(m ²)	(Sabins)	Coefficient
100	0.35	3.77	0.05
** 125	1.12	12.09	0.17
160	1.22	13.16	0.18
200	1.64	17.62	0.24
** 250	1.93	20.72	0.29
315	2.67	28.78	0.40
400	3.22	34.65	0.48
** 500	4.12	44.34	0.62
630	4.76	51.26	0.71
800	5.12	55.09	0.77
** 1000	5.38	57.86	0.80
1250	5.52	59.37	0.82
1600	5.68	61.18	0.85
** 2000	5.96	64.13	0.89
2500	6.27	67.51	0.94
3150	6.30	67.80	0.94
** 4000	6.15	66.21	0.92
5000	6.42	69.11	0.96
	~ · · ·		

SAA = 0.65 NRC = 0.65



INVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104

An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

Test Report

FOUNDED 1918 BY WALLACE CLEMENT SABINE RALTM-A20-301

Page 5 of 8

FabriTRAK Systems Inc. 2020-07-14

TEST RESULTS (continued)

The sound absorption average (SAA) is defined in ASTM C423-17 Section 3.1.1 as the arithmetic average of the sound absorption coefficients of a material for the twelve one-third octave bands from 200 Hz through 2500 Hz, inclusive, rounded to the nearest integer multiple of 0.01.

The noise reduction coefficient (NRC) is defined from previous versions of ASTM C423 as the arithmetic average of the sound absorption coefficients at 250 Hz, 500 Hz, 1000 Hz, and 2000 Hz, rounded to the nearest integer multiple of 0.05.

Tested by Report by_ Marc Sciaky Malcolm Kelly

Senior Experimentalist

Acoustical Test Engineer

Approved b Eric P. Wolfram Laboratory Manager

NVLAP LAB CODE 100227-0

🐵 RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134

630-232-0104

An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

RALTM-A20-301


Test Report

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Page 6 of 8

FabriTRAK Systems Inc. 2020-07-14

SOUND ABSORPTION REPORT

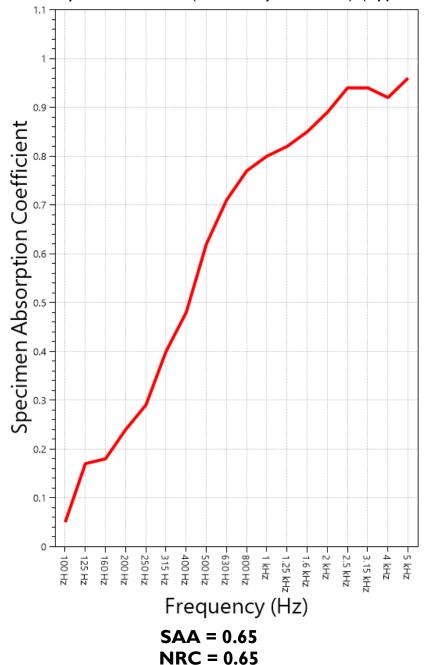

I in. Terra Core Poly Tackable Infill (100% Polyester Infill) (Type A mounting)



(B) RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134

630-232-0104

An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

RALTM-A20-301

Test Report

FOUNDED 1918 BY WALLACE CLEMENT SABINE

Page 7 of 8

FabriTRAK Systems Inc. 2020-07-14

APPENDIX A: Extended Frequency Range Data

Specimen: 1 in. Terra Core Poly Tackable Infill (100% Polyester Infill) (Type A mounting) (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-17, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	Total Absorption (Sabins)	Absorption Coefficient
31.5	-0.99	-0.01
40	3.69	0.05
50	-2.30	-0.03
63	4.64	0.06
80	-2.51	-0.03
100	3.77	0.05
125	12.09	0.17
160	13.16	0.18
200	17.62	0.24
250	20.72	0.29
315	28.78	0.40
400	34.65	0.48
500	44.34	0.62
630	51.26	0.71
800	55.09	0.77
1000	57.86	0.80
1250	59.37	0.82
1600	61.18	0.85
2000	64.13	0.89
2500	67.51	0.94
3150	67.80	0.94
4000	66.21	0.92
5000	69.11	0.96
6300	71.14	0.99
8000	73.38	1.02
10000	80.26	1.11
12500	73.64	1.02



(B) RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE GENEVA, IL 60134 630-232-0104 An MALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

Test Report

FOUNDED 1918 BY WALLACE CLEMENT SABINE

FabriTRAK Systems Inc. 2020-07-14

APPENDIX B: Instruments of Traceability

Specimen: 1 in. Terra Core Poly Tackable Infill (100% Polyester Infill) (Type A mounting) (See Full Report)

		Serial	Date of	Calibration
Description	Model	<u>Number</u>	Certification	Due
System 1	Type 3160-A-042	3160- 106968	2020-06-26	2021-06-26
Bruel & Kjaer Mic And Preamp A	Type 4943-B-001	2311428	2019-09-27	2020-09-27
Bruel & Kjaer Pistonphone	Type 4228	2781248	2019-08-09	2020-08-09
Omega Digital Temp., Humid. And Pressure Recorder	OM-CP- PRHTemp2000	P97844	2020-02-18	2021-02-18

APPENDIX C: Revisions to Original Test Report

Specimen: 1 in. Terra Core Poly Tackable Infill (100% Polyester Infill) (Type A mounting) (See Full Report)

Date	Revision
2020-07-20	Original report issued

END



INVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2017 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

RALTM-A20-301

Page 8 of 8